




## 85 EAST PLAN

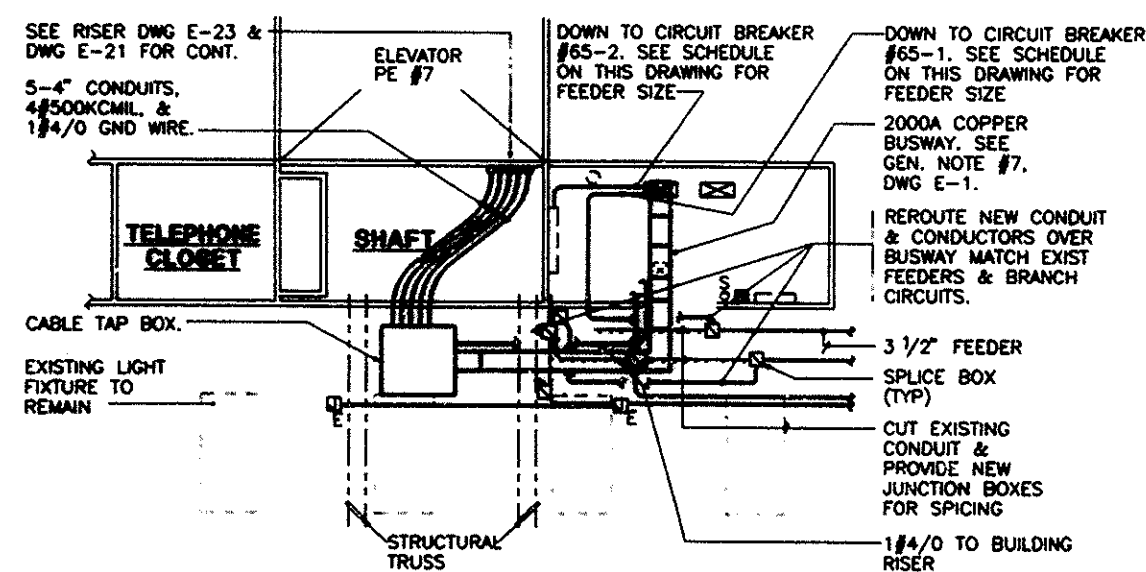

**65 EAST PLAN**

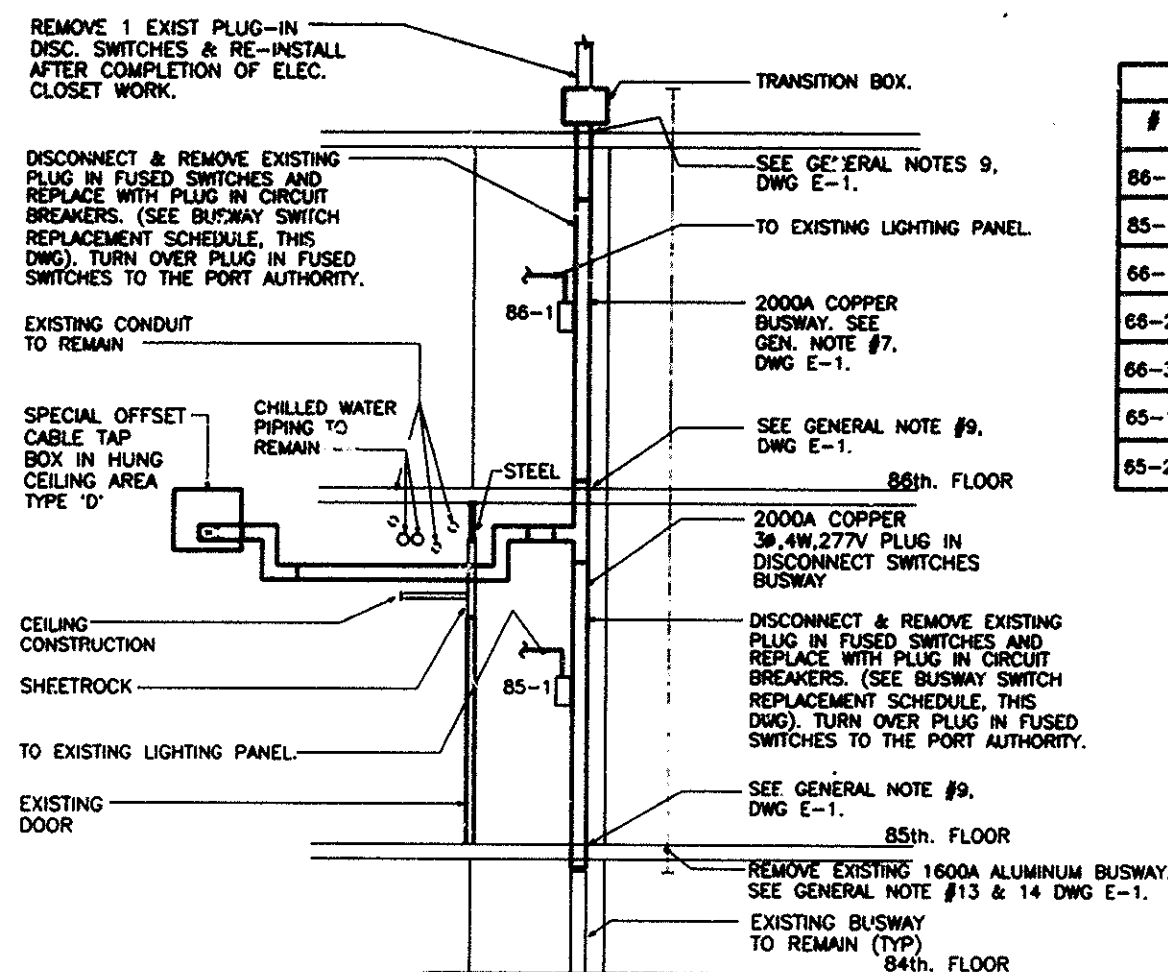

**85th FLOOR SECTION A-A**  
**& PART RISER**

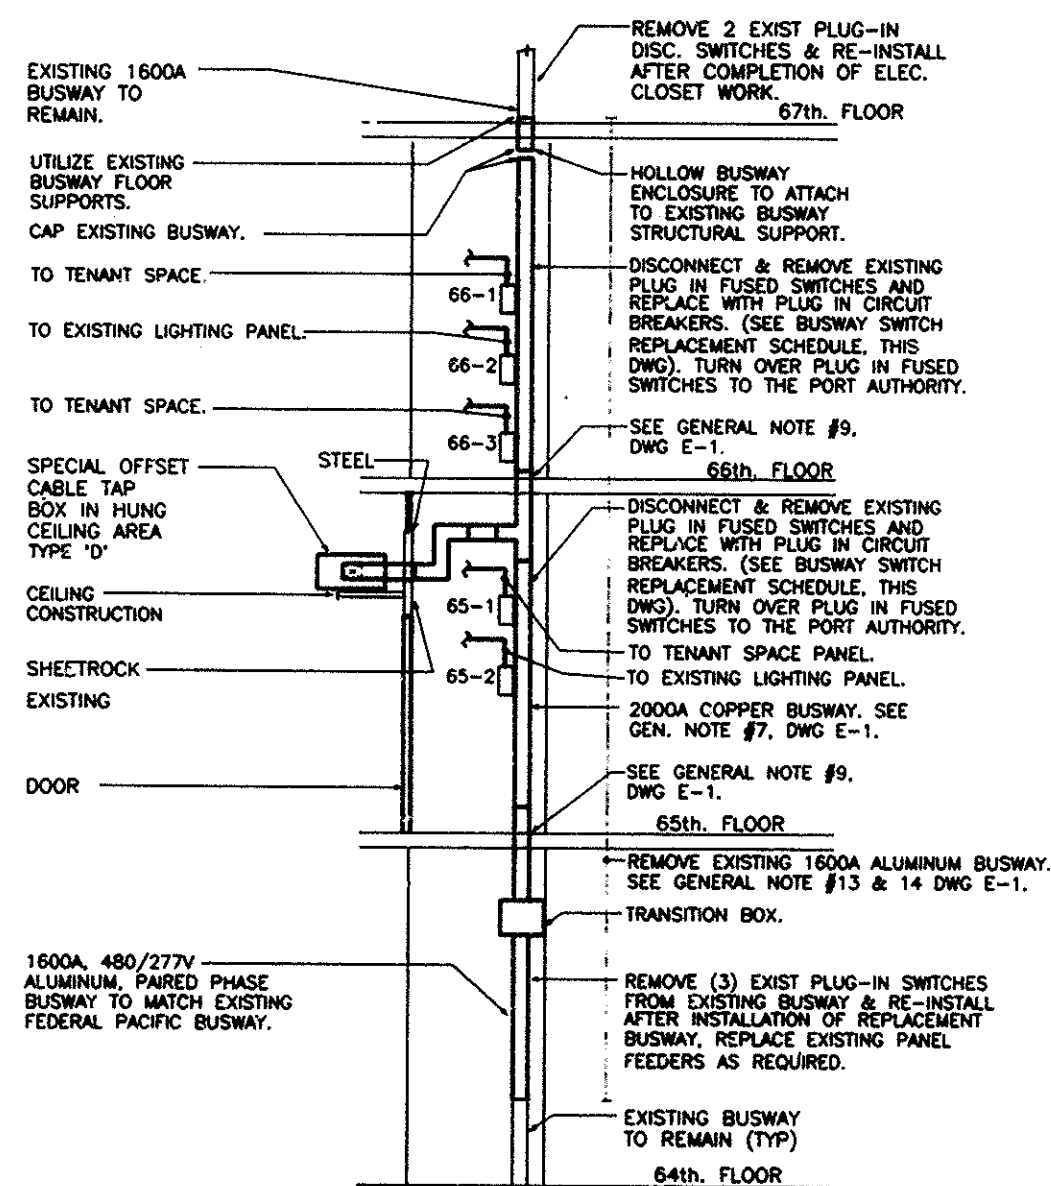


**65th FLOOR SECTION A-A**  
**& PART RISER**

BUSWAY SWITCH REPLACEMENT SCHEDULE						
#	EXIST. SW. SIZE	EXIST. FUSE RATING	NEW BREAKER RATING	NEW FEEDER	NEW CDT	REMARKS
86-1	200A	125A	225AF/125AT	4#1 CU	1 1/2"	
85-1	200A	125A	225AF/125AT	4#1 CU	1 1/2"	
66-1	200A	200A	225AF/200AT	4#3/0 CU	2"	
68-2	200A	125A	225AF/125AT	4#1 CU	1 1/2"	
66-3	200A	200A	225AF/200AT	4#3/0 CU	2"	
65-1	200A	200A	225AF/200AT	4#3/0 CU	2"	
65-2	200A	125A	225AF/125AT	4#1 CU	1 1/2"	

**NOTES:**

1. SEE DRAWING E-1 FOR BUSWAY SCHEDULE & GENERAL NOTES.
2. INTERCEPT EXISTING PANELBOARD FEEDERS, SERVING TENANT SPACE PANELBOARDS, IN TENANT HUNG CEILING AREA. PROVIDE PULLBOX, FOR SPLICING.

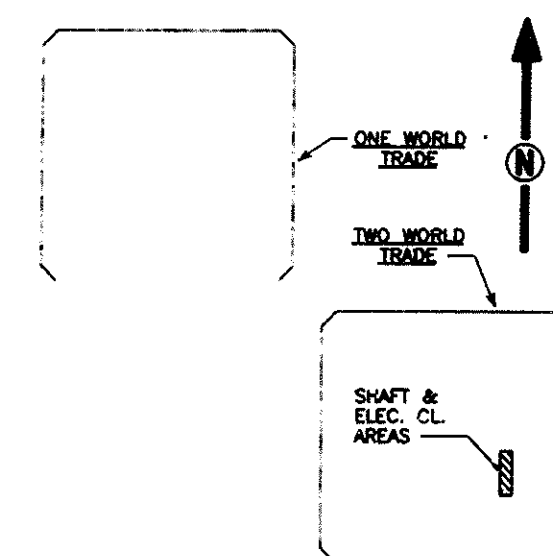

**WORK AREA KEY PLAN**



**THE FORT AGENCY  
OF NY & NJ**

  
Engineering Program Manager

**EDWARDS AND ZUCK, P.C.**  
CONSULTING ENGINEERS  
330 West 42nd Street, New York, NY 10036  
212-736-3400  
© 1982 Edwards and Zuck, P.C.



1	3/15/01	Drawings of Record	
No.	Date	Revision	Approved

Engineering Department				
Design Division				

# The World Trade Center Electrical/HVAC Upgrade Program

**Title**  
**LOW VOLTAGE DISTRIBUTION**  
**TWO WTC**  
**ELECTRICAL**  
**65TH & 85TH FLOOR**  
**EAST SIDE**

### ELECTRIC CLOSET PART PLAN

This drawing subject to conditions in contract.  
All inventions, ideas, designs and methods  
herein are reserved to Port Authority and  
may not be used without it's written consent.

<u>CJ/CADD</u>	<u>MW/CADD</u>	<u>FJL</u>
Designed by	Drawn by	Checked by

Date 10/4/93      Scale 1/4" = 1'-0"

Contract Number	Drawing Number
-----------------	----------------

WCT-804.041 E-22